


CONTINUE WITH D.I.P. OR
SWITCH TO C-900 OR C-909.

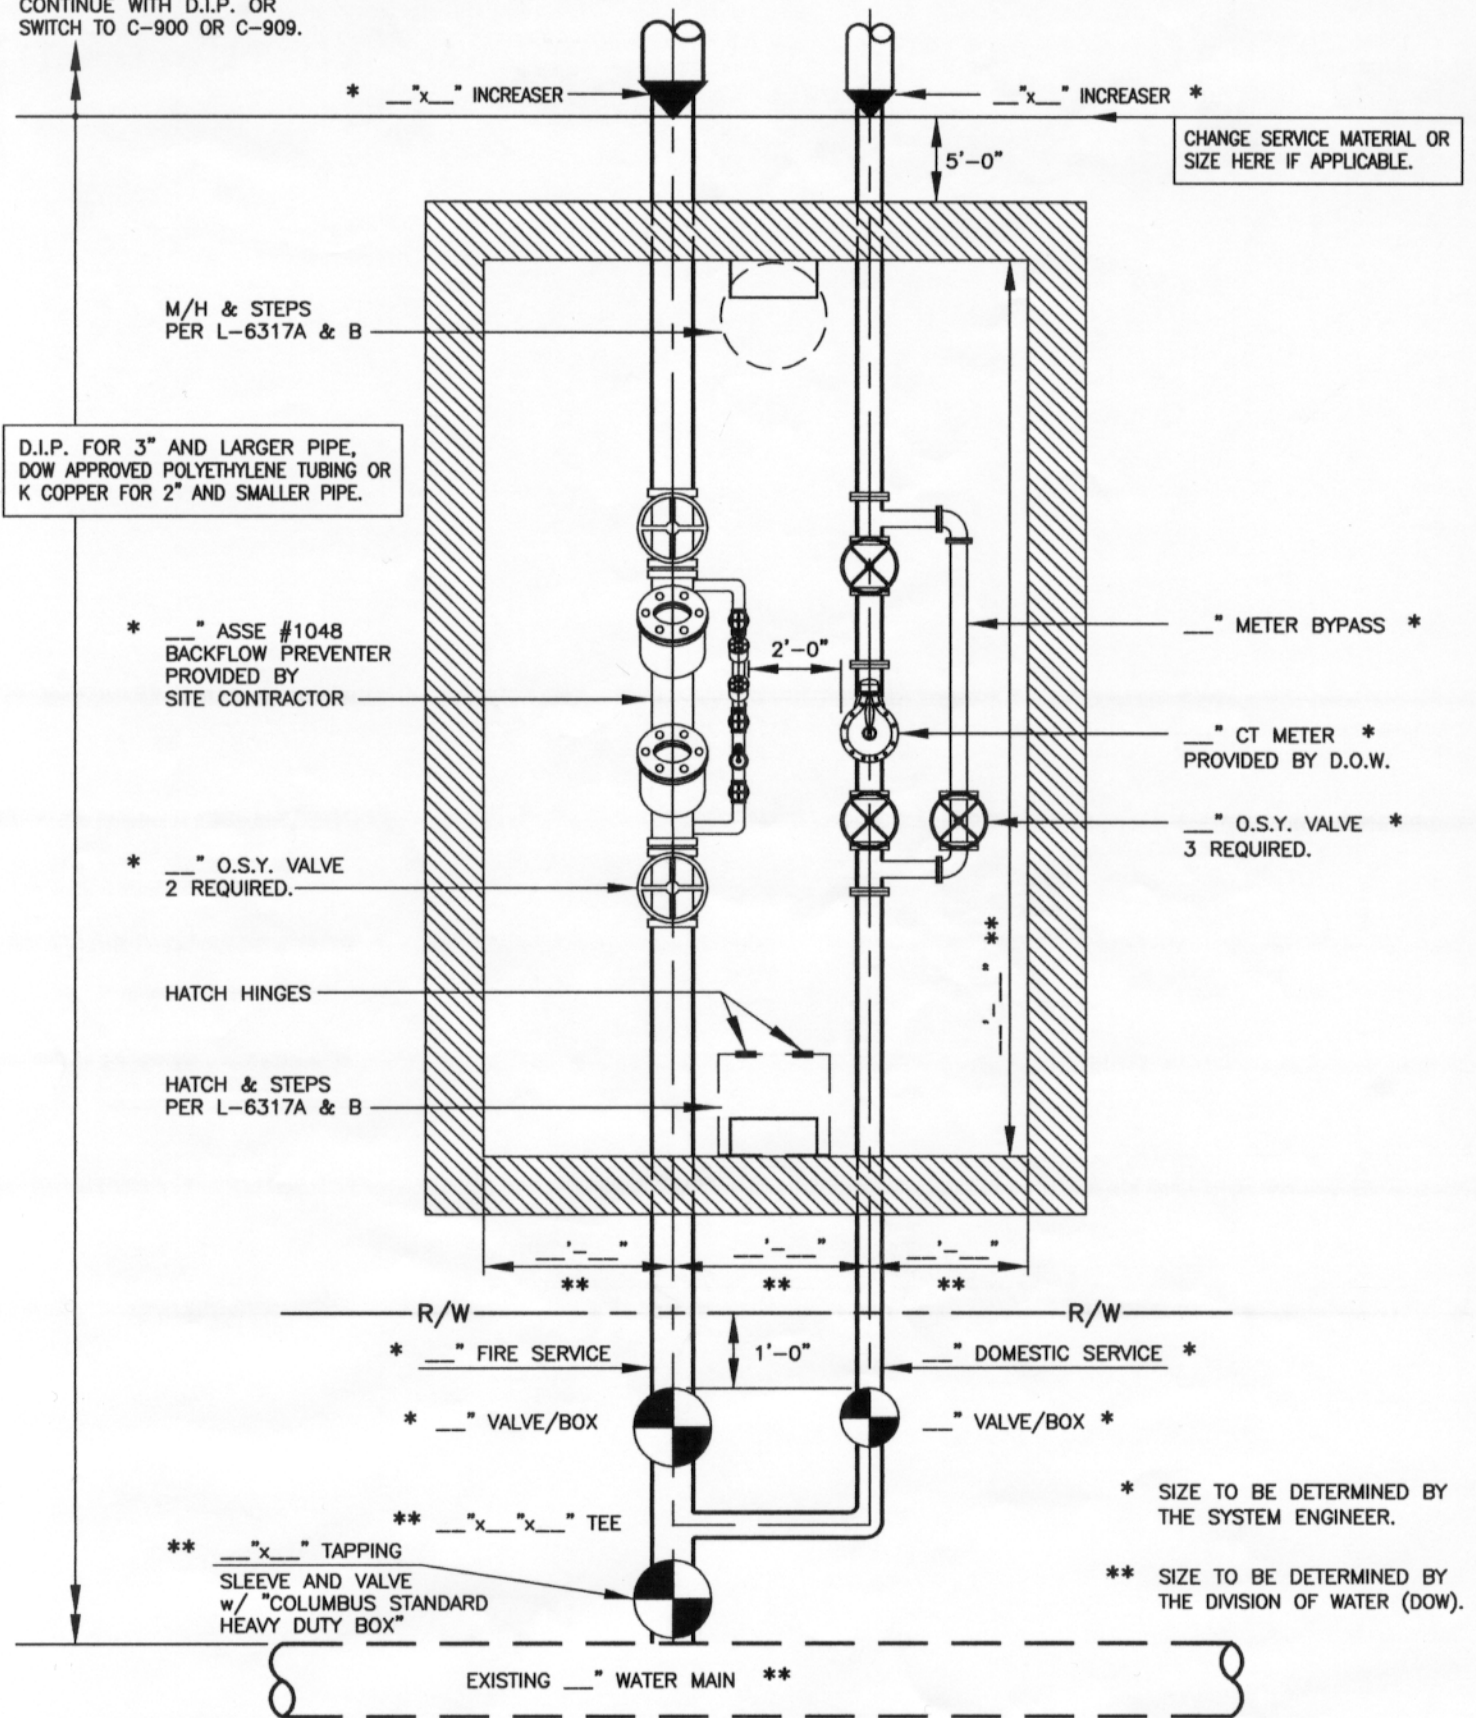

SEE DETAILS L-6317A AND L-6317B FOR VAULT DETAILS NOT SHOWN ON THIS DETAIL.

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:

ENGINEER

Jeff Hubbard

4/1/01
DATE

STANDARD DETAIL
Dual Meter Setting

L-6317E